



If you are considering using this module for special purpose such as nuclear power plants, aerospace, medical care or passenger vehicles please refer to our sales representative.

**CC-Link IE field network Basic communication Unit (EcoMonitorLight, EcoMonitorPlus)**  
Model EMU4-CM-CIFB

**User's Manual**

- Before using the product, please read this manual carefully to ensure correct use.
- Make sure that the end users read this manual and then keep the manual in a safe place for future reference.
- Make sure to deliver this manual to the end-user.
- About related materials
- You can download Programming Manual (Material number: LEN190086) of this Unit from the following website. <http://www.mitsubishielectric.com/ifa/>

**1. Features**

- This Unit is the optional dedicated product for Energy Measuring Unit (EcoMonitorLight, EcoMonitorPlus)
- This Unit enables to transfer measured data to programmable controllers for data acquisition via CC-Link IE field network Basic communication.

**2. Checking package content**

These following items for this unit are included in package. Check that no items are missing.  
(1) This Unit \*1 (2) User's manual \*1

**3. Safety Precautions**

**3.1 Precautions for Operating Environment and Conditions**

This Unit is premised on being used in pollution degree 2 environment. When used in higher pollution degree, protect this Unit from pollution on another device side to be incorporated. For the definition of the pollution degree and the over voltage category, refer to EN1010-1/2010.

Do not use this product in the places listed below. Failure to follow the instruction may cause malfunctions or decrease of product life.

- Places the Ambient temperature exceeds the range 5 to +55°C
- Dust, corrosive gas, saline and oil smoke exists or flying
- Places the Relative humidity exceeds the range 30 to 85% or places with dewfall
- Places exposed to rain or water drop
- Operating altitude exceeds 2000m
- Vibration and impact exceed the specifications
- Places metal fragments or conductive substance are flying
- Places the average daily temperature exceeds +35°C
- Places in strong electromagnetic field or places large amounts of external noise exist
- Places exposed to direct sunlight.

This Unit is the open type device, which are designed to be housed within another device for prevention of electric shock. House this unit within the device such as the control panel before use. (Indoor use)


**3.2 Matters concerning the precaution before use**

- Use the Unit in the specified usage environment and conditions.
- Before using this Unit, it is required to set this unit IP address, and subnet mask.
- For the setting methods, refer to the Programming Manual.


**3.3 Installation and connection Precautions**

- For installation and wiring works, make sure that the power source is shut off for all outside phases.
- If all phases are not turned off, it may cause an electric shock or product damages.

**6.3 Screw mounting \*EcoMonitorLight only.**

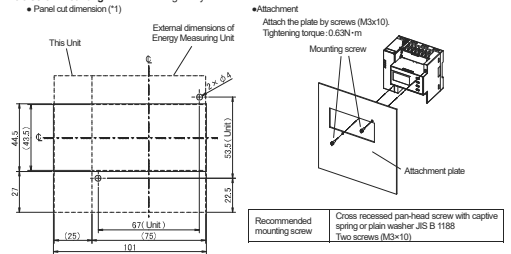

**6.4 Screw mounting (When using the attachment for panel mounting (Model: EMU4-PAT)) \*EcoMonitorLight only.**

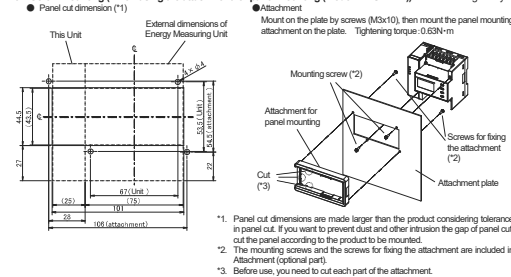

1. Panel cut dimensions are made larger than the product considering tolerance in panel cut. If you want to prevent dust and other intrusion the gap of panel cut, cut the panel according to the product to be mounted.
2. The mounting screws and the screws for fixing the attachment are included in Attachment (optional part).
3. Before use, you need to cut each part of the attachment.

**CAUTION**

- Any person who is involved in installation and wiring of this Unit should be fully competent to do this work.
- Work under the electric outage condition when installing and wiring. Failure to do so may cause electric shock or a failure of the Unit, a fire etc.
- In 100Mbps communication by the 100BASE-TX connection, a communication error may occur under the influence of high frequency noise from devices other than this device in the installation environment.
- Take the following action to prevent the influence of high frequency noise in the construction of a network system.
  - (1) Wiring connection
    - Do not install an Ethernet cable together with the main circuit and power cables, etc.
    - Place the Ethernet cable in a duct.
  - (2) Communication system
    - Increase the number of communication retries if necessary.

**3.4 Precautions for Use**

- Before operating the product, check that active bare wire and so on does not exist around the product. If any exposed conductor is found, stop the operation immediately and take an appropriate action such as isolation protection
- In the event of a power outage during the setting, the Unit is not set correctly. Please set again after power recovery.
- When you connect to Energy Measuring Unit of the Unit, Contrast of the LCD display of Energy Measuring Unit is reduced to small.
- For details in settings and usage, see the Programming Manual.

**DANGER**

- Do not touch the live part. It may cause electric shock, electric burn injury or burnout of the device.
- Work under the electric outage condition when installing and wiring.

**CAUTION**

- Do not disassemble or modify this Unit. It may cause failure, malfunction, injury or fire.
- Do not touch the communication connectors when communicating. It may cause a malfunction or failure of the Unit.

**3.5 Maintenance Precautions**

- Use a soft dry cloth to clean off dirt of the Unit surface. Do not let a chemical cloth remain on the surface for an extended period of time nor wipe the surface with thinner or benzene.
- Check for the following items to use this Unit properly for long time.
  - Daily maintenance-
    - (1) No damage on this Unit
    - (2) No abnormality with LED indicators
    - (3) No abnormal noise, smell or heat
  - Periodical maintenance- (Once every 6 months to 1 year)
    - No looseness with installation and wire connection (Check under the power failure condition. Failure to do so may cause electric shock, failure of the Unit or a fire.)

**3.6 Storage Precautions**


- To store this Unit, put it in a plastic bag. For long-time storage, avoid the following places. Failure to follow the instruction may cause a failure and reduced life of the Unit.
  - Places the ambient temperature exceeds the range -10 to +60°C
  - Places the average daily temperature exceeds +35°C
  - Places exposed to rain, water drop or direct sunlight
  - Vibration and impact exceed the specifications
  - Places the Relative humidity exceeds the range 30 to 85% or places with dewfall
  - Places metal fragments or conductive substance are flying
  - Places where dust, corrosive gas, saline and oil smoke exist

**3.7 Disposal Precautions**


- When disposing of this Unit, treat it as industrial waste.

**3.8 About packaging materials and this manual**  
For reduction of environment load, packaging materials are produced with cardboard.


**7. Wiring Diagram**

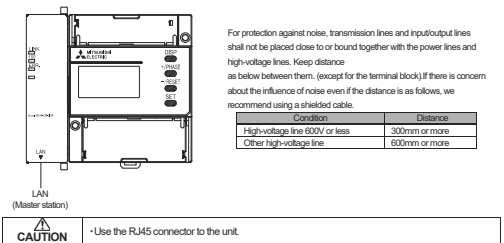

**8. External dimensions**

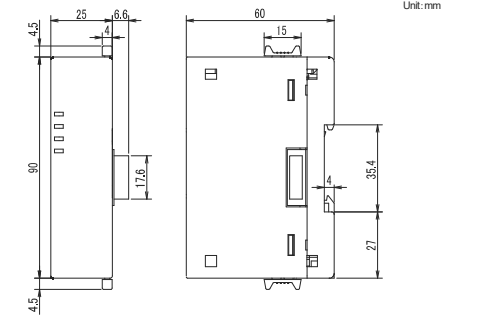

**4. Name and function of each part**

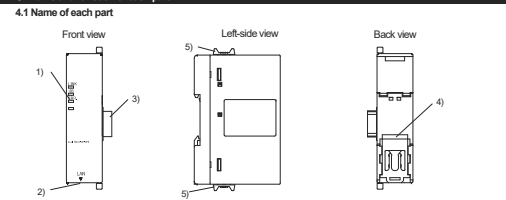


No.	Name of each part	Functions
1)	LED	Operation status of CC-Link IE field network Basic communication is displayed. For more details, see 4.2 Indication and functions of LEDs.
2)	Communication connector	100BASE-TX connector (RJ45)
3)	Connector for main unit	Connect the Energy Measuring Unit.
4)	IEC rail stop	This is used to fix to an IEC rail.
5)	Connection stop	This is used to connect this unit to the Energy Measuring Unit.

**4.2 Indication and functions of LEDs**

Name	Function	Status
LINK	Indicate communication status of this unit.	ON: communication is possible Blink: connecting OFF: not connection
100	Indicate communication speed of this unit.	ON: connecting (100Mbps) OFF: not connection
ERR	Indicate occurrence status of error of this unit.	Blink: An error occurs OFF: No alert

**5. How to wire**

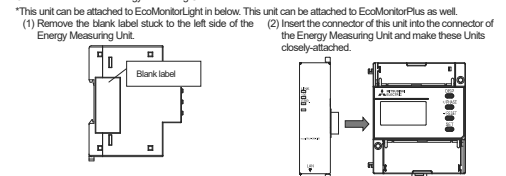


**9. Specifications**

Item	Specifications	
Product	Energy Measuring Unit (EcoMonitorLight, EcoMonitorPlus) CC-Link IE field network Basic communication Unit EMU4-CM-CIFB	
Model	EMU4-CM-CIFB	
Ratings	6.4V DC (Powered by the Energy Measuring Unit)	
Accommodating model	Energy Measuring Unit EcoMonitorLight (Model EMU4-BD1-MB / EMU4-HD1-MB / EMU4-FD1-MB *1) EcoMonitorPlus (Model EMU4-BM1-MB / EMU4-HM1-MB / EMU4-LG1-MB / EMU4-CNT-MB / EMU4-A2 / EMU4-VA2 / EMU4-PX4 / EMU4-AX4)	
Standard	EMC: EN-61326-1:2013	
Usage environment	Operating temperature	from -5 to +55°C (average daily temperature is not more than +35°C)
	Operating humidity	30 to 85% RH (No condensation)
	Storage temperature	from -10 to +60°C (average daily temperature is not more than +35°C)
	Operating altitude	Not more than 2000m
Mass	0.1kg *Mass of this unit only	

**< CC-Link IE field network Basic communication specifications >**


Item	Specifications
Interface	1 port (100BASE-TX)
Transmission method	Base band
Maximum connection devices *2	64 devices
Standard response time	300ms
Number of cascade connection stages *3	Max 2 stages
Number of occupied stations	One occupied station
Transmission speed	100Mbps
Maximum station-to-station distance *4	100m
Connector applicable for external wiring	RJ45
Cable *2	Cable compliant with the IEEE802.3 100BASE-TX Standard (Ethernet cable, Category 5e)
Protocol	CC-Link IE field network Basic, SLMP
Functions supported	Auto MDIX function (straight/crossover cable automatically detected)

1. This unit is exclusively for overseas.
2. In case you are using products with more severe restrictions than this product, follow the restrictions of the applicable product.
3. This is the maximum number of cascade connection stages when a repeater hub is used. For the maximum number of cascade connection stages, contact to the manufacturer for the switching hub used.
4. For maximum distance of switching hub-to-switching hub, consult the manufacturer of the switching hub used.

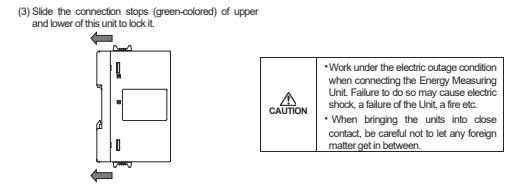


**6. Mounting the Unit**

There are two mounting methods, surface mounting and panel mounting.  
**6.1 Mounting the Unit on an IEC rail**  
\*This unit can be attached to EcoMonitorPlus as well.

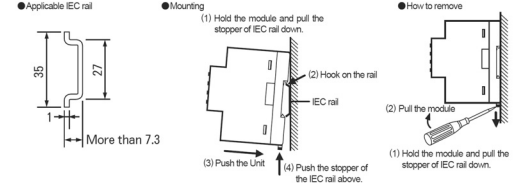

**6.2 JS agreement size mounting**  
\*This unit can be attached to EcoMonitorPlus as well.

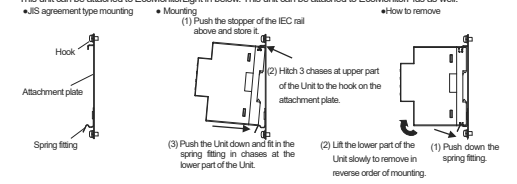

**10. Contained harmful substances**

(1) 电器电子产品有害物质限制使用标识

根据《电器电子产品有害物质限制使用管理办法》，该标识适用于在中国销售的电器电子产品。其的数字为产品的环保使用期限。只要遵守本产品在安全和使用方面的注意事项，从生产日期起的环保使用期限内会造成环境污染或对人体、财产产生深刻的影响。  
注：产品正常使用废弃后，应按照国家和地方的法律法规完成该电器电子产品的回收和再利用。

(2) 产品中有毒物质的名称及含量  
本产品中所含有的 6 种有毒物质的名称、含有信息及含有部件如下表所示。

部件名称	有毒物质					
	铅 (Pb)	汞 (Hg)	镉 (Cd)	六价铬 (Cr (VI))	多环联苯 (PBB)	多溴二苯醚 (PBDE)
基板	×	○	○	○	○	○
箱子	○	○	○	○	○	○
铭牌	○	○	○	○	○	○

本表格依据 SJ/T11364 的规定编制。  
○：表示该有毒物质在该部件所有均质材料中的含量均符合 GB/T 26572 规定的限量要求以下。  
×：表示该有毒物质至少在该部件的某一均质材料中的含量超出 GB/T26572 规定的限量要求。且目前尚无有效的替代方案，但是符合欧盟 RoHS 指令要求。

**11. After-sales service**

- If you have any questions or the product is broken down, contact our sales representative near you
- The charge-free warranty is effective until the earlier of 1 year after the date of your purchase or 18 months after manufacturing.
- The gratis warranty shall apply if the product fails even though it is being used properly in the conditions, with the methods and under the environments in accordance with the terms and precautions described in the catalogs, the instruction manual, caution label on the product, etc.
- Regardless of Gratis Warranty Period, our company shall not be liable to compensate for any loss arising from events not attributable to our company, opportunity loss and lost earning of the customer due to failure of the product, and loss, secondary loss, accident compensation, damage to other products and other operations caused by a special reason regardless of our company's predictability.
- If the equipment is used in a manner not specified by the manufacturer, the protection provided by the equipment may be impaired.

**CAUTION**

- If an abnormal sound, bad-smelling smoke, fever break out from this Unit, switch it off promptly and don't use it.

**12. Customer Service**

**MITSUBISHI ELECTRIC CORPORATION**  
HEAD OFFICE: TOKYO BUILDING, 2-7-3, MARUNOUCHI, CHIYODA-KU, TOKYO 100-8310, Japan  
Please refer to "catalog" for more detail.