

MITSUBISHI ELECTRIC

GOT2000/GOT1000 Series CC-Link IE Field Network Communication Unit

User's Manual

GT15-J71GF13-T2

Thank you for choosing Mitsubishi Electric Graphic Operation Terminal (GOT).

Prior to use, please read both this manual and detailed manual thoroughly to fully understand the product.

MODEL	GT15-J71GF13-T2-U
MODEL CODE	1D7ME6
IB(NA)-0800473-J(2306)MEE	

© 2011 MITSUBISHI ELECTRIC CORPORATION

SAFETY PRECAUTIONS
(Always read these precautions before using this equipment.)

Before using this product, please read this manual and the relevant manuals introduced in this manual carefully and pay full attention to safety to handle the product correctly.

The precautions given in this manual are concerned with this product. In this manual, the safety precautions are ranked as "WARNING" and "CAUTION".

WARNING Indicates that incorrect handling may cause hazardous conditions, resulting in death or severe injury.

CAUTION Indicates that incorrect handling may cause hazardous conditions, resulting in medium or slight personal injury or physical damage.

Note that the CAUTION level may lead to a serious accident according to the circumstances. Always follow the precautions of both levels because they are important to personal safety. Please save this manual to make it accessible when required and always forward it to the end user.

INSTALLATION PRECAUTIONS

WARNING

- Be sure to shut off all phases of the external power supply used by the system before mounting or removing this unit from the GOT. Not doing so can cause a unit failure or malfunction.

CAUTION

- Use this unit in the environment that satisfies the general specifications described in the User's Manual for the GOT used. Not doing so can cause an electric shock, fire, malfunction or product damage or deterioration.
- When installing this unit to the GOT, fit it to the connection interface of the GOT and tighten the mounting screws in the specified torque range (0.36 N·m to 0.48 N·m) with a Phillips-head screwdriver No.2. Under-tightening can cause a drop, failure or malfunction. Overtightening can cause a drop, failure or malfunction due to screw or unit damage.
- Do not directly touch the conductive part or electronic components of the unit. This may cause the unit to fail or malfunction.

DESIGN PRECAUTIONS

WARNING

- If a communication fails in data link, the faulty station holds the data link data generated before the communication error. Create an interlock circuit in the sequence program using the communication status information in order that the system will operate safely. Failure to do so may cause mis-outputs or malfunctions, resulting in accidents. Check the faulty station and the operation status during communication error by referring to the relevant manuals.
- Some failures of cable or communication unit may cause the GOT to keep the outputs on or off. Create an external circuit for monitoring output signals that may lead to serious accidents. Failure to do so may cause mis-outputs or malfunctions, resulting in accidents.
- If a communication error (including cable disconnection) occurs during monitoring, the communication between the GOT and programmable controller CPU may be interrupted and the GOT may be inoperative. For bus connection: The programmable controller CPU is down and the GOT is inoperative. For other than above: The GOT is inoperative. When configuring a system including the GOT, the possibility of GOT communication error must be considered; make sure the operation significant for the system will be performed by switches on devices other than the GOT. Failure to do so may cause mis-outputs or malfunctions, resulting in accidents.
- To maintain the security (confidentiality, integrity, and availability) of the GOT and the system against unauthorized access, DoS attacks, computer viruses, and other cyberattacks from unreliable networks and devices via network, take appropriate measures such as firewalls, virtual private networks (VPNs), and antivirus solutions. Mitsubishi Electric shall have no responsibility or liability for any problems involving GOT trouble and system trouble by unauthorized access, DoS attacks, computer viruses, and other cyberattacks. *1 DoS: A denial-of-service (DoS) attack disrupts services by overloading systems or exploiting vulnerabilities, resulting in a denial-of-service (DoS) state.

CAUTION

- Do not bunch the control wires or communication cables with the main circuit or power wires, or lay them close to each other. As a guide, separate the lines by a distance of at least 100mm (3.94 inches) otherwise malfunctions may occur due to noise.

WIRING PRECAUTIONS

WARNING

- Be sure to shut off all phases of the external power supply used by the system before wiring. Failure to do so may cause electric shock, product damage or malfunctions.

CAUTION

- Be careful not to let foreign matter such as dust or wire chips get inside the unit. This may cause a fire, failure or malfunctions.
- Make sure to securely connect the cable to the connector of unit. Incorrect connection may cause malfunctions.
- Make sure to fix communication cables and power cables to the unit by ducts or clamps. Failure to do so may cause damage of the unit or the cables due to accidental pull or unintentional shifting of the cables, or malfunctions due to poor contact of the cables.
- Do not hold the cable by hand and pull it out from the unit. When removing the cable from the unit, make sure to hold the connector by hand and pull it. Failure to do so may cause malfunctions or damage to the unit or cable.

STARTUP AND MAINTENANCE PRECAUTIONS

WARNING

- Do not touch the connector while power is on. Failure to do so may cause electric shock or malfunctions.
- Before starting cleaning, always shut off GOT power externally in all phases. Not doing so can cause a unit failure or malfunction.

CAUTION

- Do not disassemble or modify any unit. This will cause failure, malfunction, injuries, or fire.
- Do not touch the conductive areas and electronic parts of this unit directly. Doing so can cause a unit malfunction or failure.
- Make sure to externally shut off all phases of the power supply before cleaning the unit and rightening unit mounting screws. Failure to do so may cause the unit to fail or malfunction. Loose tightening may cause a fall of the unit, short circuits, or malfunctions. Overtightening may damage the screws and/or the unit, resulting in a fall of the unit, short circuits or malfunctions.

STARTUP AND MAINTENANCE PRECAUTIONS

CAUTION

- Make sure to touch the grounded metal to discharge the electricity charged in the body, etc. before touching the unit. Failure to do so may cause a failure or malfunctions of the unit.

DISPOSAL PRECAUTIONS

CAUTION

- Dispose of this product as industrial waste.

TRANSPORTATION PRECAUTIONS

CAUTION

- Make sure to transport the GOT main unit and/or relevant unit(s) in the manner they will not be exposed to the impact exceeding the impact resistance described in the general specifications of the User's Manual for the GOT used, as they are precision devices. Failure to do so may cause the unit to fail. Check if the unit operates correctly after transportation.
- When fumigants that contain halogen materials such as fluorine, chlorine, bromine, and iodine are used for disinfecting and protecting wooden packaging from insects, they cause malfunction when entering our products. Please take necessary precautions to ensure that remaining materials from fumigant do not enter our products, or treat packaging with methods other than fumigation (heat method). Additionally, disinfect and protect wood from insects before packing products.

Manual

The following shows manuals relevant to this product.

Manual name	Manual number (Model code)
GOT2000 Series User's Manual (Hardware) (Sold Separately)	SH-081194ENG (1D7MJ5)
GOT2000 Series Connection Manual (Mitsubishi Products) For GT Works3 Version1 (Sold Separately)	SH-081197ENG (1D7MJ8)
GT16 User's Manual (Hardware)	SH-080928ENG
GT15 User's Manual	SH-080528ENG
GOT1000 Series Connection Manual (Mitsubishi Products) for GT Works3	SH-080868ENG

For the latest e-Manuals and PDF manuals, consult your local sales office.

Compliance with the EMC and Low Voltage Directives

To configure a system meeting the requirements of the EMC and Low Voltage Directives when incorporating the Mitsubishi GOT (EMC and Low Voltage Directives compliant) into other machinery or equipment, refer to "EMC AND LOW VOLTAGE DIRECTIVES" of the General Description included with the GOT used. The CE mark, indicating compliance with the EMC and Low Voltage Directives, is printed on the rating plate of the GOT.

Compliance with the new China RoHS directive

GOT 相关的基于“电器电子产品有害物质限制使用管理办法”要求的表示方法

15 Note: This symbol mark is for China only.


含有害6物质的名称、含有量、含有部件
本产品中所含有的有害6物质的名称、含有量、含有部件如下表所示。

部件名称	有害物质					
	铅 (Pb)	汞 (Hg)	镉 (Cd)	六价铬 (Cr(VI))	多溴联苯 (PBB)	多溴二苯醚 (PBDE)
电路板组件	×	○	○	○	○	○
树脂壳体、电缆、线材	○	○	○	○	○	○
钣金部件、螺丝等金属部件	×	○	○	○	○	○

本表依据 SJ/T11364 的规定编制。
○: 表示该有害物质在该部件所有均质材料中的含量均在 GB/T26572 规定的限量要求以下。
×: 表示该有害物质至少在该部件的某一均质材料中的含量超出 GB/T26572 规定的限量要求。

3. PART NAMES AND EXTERNAL DIMENSIONS

3.1 CC-Link IE Communication Unit

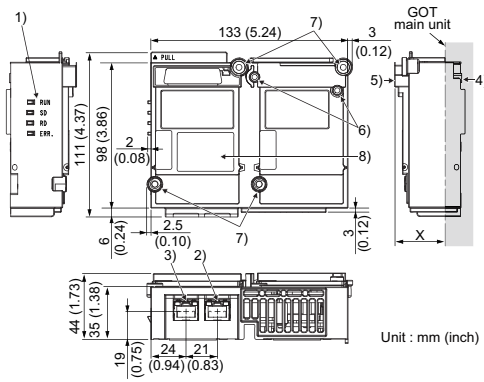

Dimensions of X when the CC-Link IE communication unit is mounted to the GOT.

GOT	GT27	GT25	GT16	GT15
15"	37 (1.46)	-	33.5 (1.32)	35 (1.38)
12.1"	37 (1.46)	37 (1.46)	32 (1.26)	32 (1.26)
10.4"	37 (1.46)	37 (1.46)	35 (1.38)	35 (1.38)
8.4"	37 (1.46)	37 (1.46)	37 (1.46)	37 (1.46)
5.7"	37 (1.46)	-	37 (1.46)	37 (1.46)

Unit: mm (inch)

No.	Name	Description
1)	Indicator LED	Indicates the operating status of the CC-Link IE communication unit.
2)	Connector (PORT1 side)	Connector for connecting an Ethernet cable (There is no restrictions for the connecting order at wiring of PORT1 and PORT2 side connectors)
3)	Connector (PORT2 side)	
4)	Interface connector	Extension connector installed to a front extension unit or the GOT
5)	Extension connector	Extension connector to which a back extension unit is installed
6)	Board fixing screw	Screws for fixing the extension interface relay board
7)	Mounting screw	Mounting screws fixed with a front extension unit or the GOT
8)	Rating plate	-

(1) Indicator LED

A LED indicates the status of the CC-Link IE communication unit and the communication status. If any communication error occurs, specify the error cause by the [NETWK unit status display] screen of the GOT utility. Refer to the User's Manual for the GOT used for details on the [NETWK unit status display] screen.


LED name	Status	Description
RUN	On	The unit is in a normal status.
	Off	Hardware failure or WDT error
SD	On	Sending data
	Off	Not sending data
RD	On	Receiving data
	Off	Not receiving data
ERR.	On	Any of the following errors occurs. • An error is detected on all stations. • Station number duplication occurs in the network. • The network parameters are corrupted. • The network parameters (including the reserved station setting, the number of connected devices, and the network number) differ from the actual connection of the devices.
	Blink	A data link error station is detected.
	Off	Normal operation

(2) LED on connector

A LED indicates the link status of the CC-Link IE communication unit and the reception status.

LED name	Status	Description
LER	Off	No error
	On	Target port frame loss
LINK	Off	Link down
	On	Link up

3.2 Extension Interface Relay Board

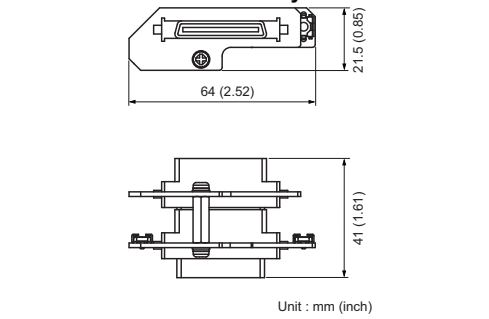


4. INSTALLATION PROCEDURE


The installation procedure for the CC-Link IE communication unit is explained using the GT1665.

- Power off the GOT.
- Remove two extension unit covers of the GOT.
- Attach the extension interface relay board to the extension interface 2 on the GOT. After the installation, detach the connector cover from the extension interface relay board. For the following GOT types, the extension interface relay board is not needed.
 - GT1655, GT155 of the GOT1000 series
 - GT27, GT25 of the GOT2000 series

4) Fit the CC-Link IE communication unit in the GOT case.

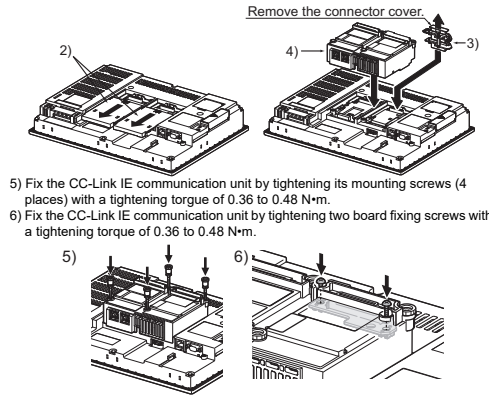

- Fix the CC-Link IE communication unit by tightening its mounting screws (4 places) with a tightening torque of 0.36 to 0.48 N·m.
- Fix the CC-Link IE communication unit by tightening two board fixing screws with a tightening torque of 0.36 to 0.48 N·m.

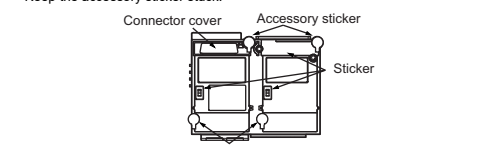


Point

Remove the screws that fixes the extension interface relay board before removing the unit. (Above 6)

5. PRECAUTIONS FOR WIRING CABLES

- Do not use Ethernet cables with exposed metal parts to prevent static electricity.
- Confirm the followings on the Ethernet cable used.
 - If there is no disconnection
 - If there is no short circuit
 - If there is no connection problem at the connectors
- Do not use Ethernet cables with broken latches. Using Ethernet cables with broken latches may cause cable disconnection or malfunction.
- When connecting or removing the Ethernet cables to/from the unit, hold the Ethernet cable connector securely with the hands.
- Connect the Ethernet cable connector and unit connector securely until you hear a click sound.
- For connecting Ethernet cables to the unit, the bending radius of the cables must be within the specified range.
- For details, check the specifications of the cables to be used.
- When installing the Ethernet cable, do not touch the cable core of the Ethernet cable connector or unit connector, or let dirt or dust collect on it. If oil from the hands, dirt or dust should adhere to the core, the transmission loss will increase, causing a malfunction in the data link.
- Wire the connector to the Ethernet cable correctly. After wiring, perform a loop test or station-to-station test or others to confirm if the setting and wiring of CC-Link IE communication unit have been done properly.
- For connectors to which Ethernet cables are not connected, keep the connector covers attached on unused connectors to prevent the entry of static electricity, dirt, and dust.



Referenced Standard: GB/T15969.2 (Requirement of Chinese standardized law)

Packing List

After unpacking the box, check that the following products are included.

Model	Product	Quantity
GT15-J71GF13-T2	CC-Link IE Field Network communication unit	1
	Mounting screw set (4 screws, 4 stickers)	1
	Extension interface relay board	1
	GOT2000/GOT1000 Series CC-Link IE Field Network Communication Unit User's Manual (This manual)	1

1. OVERVIEW

This user's manual describes the GOT2000/GOT1000 series CC-Link IE Field Network communication unit (hereinafter referred to as the CC-Link IE communication unit). The CC-Link IE communication unit allows the GOT2000 or GOT1000 series to function as an intelligent device station on the CC-Link IE Field Network. Refer to the User's Manual for the GOT used for GOT to which this unit can be installed. When using the CC-Link IE Field Network connection, make the communication setting to perform communication with programmable controllers. For the details of the CC-Link IE Field Network connection, refer to the GOT2000 or GOT1000 Series Connection Manual (Mitsubishi Products).

2. SPECIFICATIONS

The general specifications of the CC-Link IE communication unit are the same as those of the GOT. For the general specifications of the GOT, refer to the User's Manual for the GOT used. The performance specifications of the CC-Link IE communication unit are indicated below.

Item	Specifications	
Max. link device points per network	RWw 8K points (8192 points, 16Kbytes)	
	RWr 8K points (8192 points, 16Kbytes)	
Max. link device points per GOT	RX 16K points (16384 points, 2Kbytes)	
	RY 16K points (16384 points, 2Kbytes)	
	RWw 1K points (1024 points, 2Kbytes)	
	RWr 1K points (1024 points, 2Kbytes)	
Max. sending points per GOT	RX 2K points (2048 points, 256 bytes)	
	RY 2K points (2048 points, 256 bytes)	
Communication speed	RWw Online (Normal mode): 1024 points, 2Kbytes	
	RWr Online (High-speed mode): 256 points, 512 bytes	
Connection cable	RX 2K points (2048 points, 256 bytes)	
	RY 2K points (2048 points, 256 bytes)	
Max. station-to-station distance	RWw 100m (conform to ANSI/TIA/EIA-568-B (category 5e))	
	RWr 100m (conform to ANSI/TIA/EIA-568-B (category 5e))	
Transmission specifications	Overall cable distance In line connection: 12000m (when connecting 1 master station and 120 slave stations) In star connection: depends on the system configuration In ring connection: 12100m (when connecting 1 master station and 120 slave stations)	
	Max. number of cascaded stages	20 stages
	Transmission path	Line type, star type (line and star mixed type is also enabled) or ring type
Max. number of connectable stations per network	120	
Max. number of networks	239	
Communication method	Token passing method	
Max. transient transmission capacity	1920 bytes	
Internal current consumption	0.96A	
Weight	0.26kg (0.57lb)	

Warranty

Mitsubishi Electric will not be held liable for damage caused by factors found not to be the cause of Mitsubishi Electric; machine damage or lost profits caused by faults in the Mitsubishi Electric products; damage, secondary damage, accident compensation caused by special factors unpredictable by Mitsubishi Electric; damages to products other than Mitsubishi Electric products; and to other duties.

- For safe use**
 - This product has been manufactured as a general-purpose part for general industries, and has not been designed or manufactured to be incorporated in a device or system used in purposes related to human life.
 - Before using the product for special purposes such as nuclear power, electric power, aerospace, medicine or passenger movement vehicles, consult with Mitsubishi Electric.
 - This product has been manufactured under strict quality control. However, when installing the product where major accidents or losses could occur if the product fails, install appropriate backup or failsafe functions in the system.

Sales office/Tel

Americas
Mitsubishi Electric Automation, Inc. 500 Corporate Woods Parkway, Vernon Hills, IL 60061, U.S.A. Tel: +1-847-478-2100
Mitsubishi Electric do Brasil Comercio e Servicos Ltda. Avenida Adelfino Cardana, 293, 21 andar, Bethaville, Barueri SP, Brazil Tel: +55-11-4689-3000
Mitsubishi Electric Automation, Inc. Mexico Branch Boulevard Miguel de Cervantes Saavedra 301, Torre Norte Piso 5, Ampliacion Granada, Miguel Hidalgo, Ciudad de Mexico, Mexico, C.P. 11520 Tel: +52-55-3067-7512
Europe
Mitsubishi Electric Europe B.V. German Branch Mitsubishi-Electric-Platz 1, 40882 Ratingen, Germany Tel: +49-2102-485-0
Mitsubishi Electric Europe B.V. UK Branch Travellers Lane, UK-Hatfield, Hertfordshire, AL10 8XB, U.K. Tel: +44-1707-28-8780
Mitsubishi Electric Europe B.V. Italian Branch Centro Direzionale Colleoni - Palazzo Sino, Viale Colleoni 7, 20864 Agrate Brianza (MB), Italy Tel: +39-039-60531
Mitsubishi Electric Europe B.V. Spanish Branch Carretera de Rubi, 76-80-Appdo. 420, E-08190 Sant Cugat del Valles (Barcelona), Spain Tel: +34-935-65-3131
Mitsubishi Electric Europe B.V. French Branch 25, Boulevard des Bouvets, 92741 Nanterre Cedex, France Tel: +33-1-55-68-55-68
Mitsubishi Electric Europe B.V. Czech Branch Pekarska 52/17, 155 00 Praha 5, Czech Republic Tel: +420-255 719 200
Mitsubishi Electric Turkey A.S. Umraniye Branch Serifas Mahallesi Nispetiye Sokak No:5, TR-34775 Umraniye / Istanbul, Turkey Tel: +90-216-526-3990
Mitsubishi Electric Europe B.V. Polish Branch ul. Krakowska 48, 32-083 Balice, Poland Tel: +48-12-347-65-00
Africa
Adroit Technologies 20 Waterford Office Park, 189 Witkoppen Road, Fourways, South Africa Tel: +27-11-658-8100
Asia-Pacific
Mitsubishi Electric Automation (China) Ltd. Mitsubishi Electric Automation Center, No.1386 Hongqiao Road, Shanghai, China Tel: +86-21-2322-3030
SETSUYO ENTERPRISE CO., LTD. 6F, No. 105, Wugong 3rd Road, Wugu District, New Taipei City 24889, Taiwan Tel: +886-2-2299-2499
Mitsubishi Electric Automation Korea Co., Ltd. 7F to 9F, Gangseo Hangang Xi-tower A, 401, Yangcheon-ro, Gangseo-Gu, Seoul 07528, Korea Tel: +82-2-3950-9559
Mitsubishi Electric Asia Pte. Ltd. 307 Alexandra Road, Mitsubishi Electric Building, Singapore 159943 Tel: +65-6473-2308
Mitsubishi Electric Factory Automation (Thailand) Co. Ltd. 12th Floor, SIV City Building, Office Tower 1, No. 599/19 and 20 Rama 3 Road, Kwang Bangpangpang, Khiet Yanwawa, Bangkok 10120, Thailand Tel: +66-2682-6522 to 31
PT. Mitsubishi Electric Indonesia Gedung Jaya 8th Floor, Jl. MH. Thamrin No. 12, Jakarta Pusat 10340, Indonesia Tel: +62-21-3192-6461
Mitsubishi Electric Vietnam Company Limited 11th & 12th Floor, Viettel Tower B, 285 Cach Mang Thang 8 Street, Ward 12, District 10, Ho Chi Minh City, Vietnam. Tel: +84-28-3910-5945
Mitsubishi Electric India Pvt. Ltd. Pune Branch Emerald House, EL-3, J Block, M.I.D.C., Bhoasri, Pune - 411026, Maharashtra, India Tel: +91-20-2710-2000
MITSUBISHI ELECTRIC AUSTRALIA PTY. LTD. 348 Victoria Road, P.O. Box 11, Rydalmere, N.S.W. 2116, Australia Tel: +61-2-9684-7777

MITSUBISHI ELECTRIC CORPORATION

HEAD OFFICE: TOKYO BLDG., 2-7-3, MARUNOUCHI, CHIYODA-KU, TOKYO 100-8310, JAPAN
NAGOYA WORKS: 1-14, YADA-MINAMI 5-CHOME, HIGASHI-KU, NAGOYA 461-8670, JAPAN

When exported from Japan, this manual does not require application to the Ministry of Economy, Trade and Industry for service transaction permission.
Specifications subject to change without notice.
Printed in Japan, June 2023.