

RINA Certificate Approval and Relevant Requirements FX3S series PLC

■Date of Issue

June 2020

■Relevant Models

MELSEC-F FX3S series

Thank you for your continued support of Mitsubishi Electric programmable controllers, MELSEC-F series.

The following MELSEC-F FX_{3S} series products have also acquired the type approval certificate for Programmable Logic Controller from RINA (Registro Italiano Navale).

1 APPLICABLE MODELS

Type	Model name
Main Units (AC Power Supply)	FX _{3S} -10MR/ES, FX _{3S} -10MT/ES, FX _{3S} -10MT/ESS FX _{3S} -14MR/ES, FX _{3S} -14MT/ES, FX _{3S} -14MT/ESS FX _{3S} -20MR/ES, FX _{3S} -20MT/ES, FX _{3S} -20MT/ESS FX _{3S} -30MR/ES, FX _{3S} -30MT/ES, FX _{3S} -30MT/ESS FX _{3S} -30MR/ES-2AD, FX _{3S} -30MT/ES-2AD, FX _{3S} -30MT/ESS-2AD
Main Units (DC Power Supply)	FX _{3S} -10MR/DS, FX _{3S} -10MT/DS, FX _{3S} -10MT/DSS FX _{3S} -14MR/DS, FX _{3S} -14MT/DS, FX _{3S} -14MT/DSS FX _{3S} -20MR/DS, FX _{3S} -20MT/DS, FX _{3S} -20MT/DSS FX _{3S} -30MR/DS, FX _{3S} -30MT/DS, FX _{3S} -30MT/DSS
Connection Conversion Adapter	FX _{3S} -CNV-ADP

2 RINA CERTIFICATION

The following table explains the acquired RINA certification.

2.1 Acquired Certification

Item	Description
Accreditation organization	Registro Italiano Navale
Certificate No.* ¹	—
Category	Programmable Logic Controller
Test standard* ¹	—
Term of validity* ¹	—

*¹ Please ask your local Mitsubishi Electric distributor for the certificate No., test standard, and term of validity.

2.2 Certification Details

The RINA approved MELSEC-F FX_{3S} series main unit and connection conversion adapter must be used in the following environment.


Item	Description	Remarks
EMC	EMC: Any given place on vessel (Bridge and Deck Zone is included)	—
Power Supply	Supply power from a DC power source other than battery.	Refer to chapter 3.

3 REQUIREMENTS

When using the MELSEC-F FX_{3S} series main unit and connection conversion adapter in a system requiring RINA approval, make sure the following requirements are observed.

3.1 Control Cabinet

- The control cabinet must be conductive.
- Ground the control cabinet with the thickest possible grounding cable.
- To ensure that there is electrical contact between the control cabinet and its door, connect the cabinet and its doors with thick wires. (Refer to Fig. 1.)
- In order to suppress the leakage of radio waves, the control cabinet must be structured with minimal openings. The gap between the control cabinet and its door must be eliminated whenever possible by attaching EMI gaskets between them. To attach an EMI gasket, remove the coating on the contact area between the control cabinet and its door and attach the EMI gasket with conductive adhesive tape. In addition, wrap the cable holes with a shielding cover or other shielding devices. (Refer to Fig. 1.) EMC tests of Mitsubishi Electric were carried out on a cabinet with damping characteristics of 46.8 dB max. and 26.4 dB mean (measured by the 3-meter method from 30 MHz to 2 GHz) with an EMI gasket attached, whose damping characteristics were 69 dB mean (150 kHz to 100 MHz).

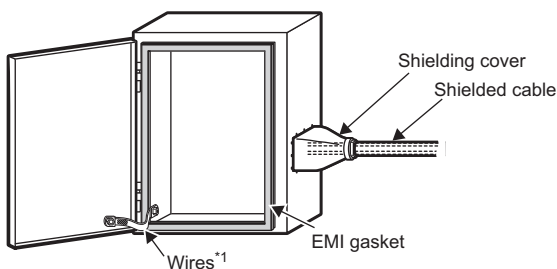

*1 These wires are used to improve the conductivity between the door and control cabinet.

Fig. 1. Control cabinet example

- In order to avoid the effects of static electricity, make sure to eliminate static electricity when there is a possibility of touching the PLC on the control cabinet during maintenance or servicing.

3.2 Cables

- Use shielded cables for cables that protrude out of the control cabinet.
- Connect the shields, such as the shielded cable and the shielding cover, to the grounded control cabinet.

3.3 Noise Filter

Please attach a noise filter on the power line. (Refer to Fig. 4.)

Mitsubishi Electric performed the EMC test with a common-mode noise filter connected in series as shown in Figs. 2 and 3.

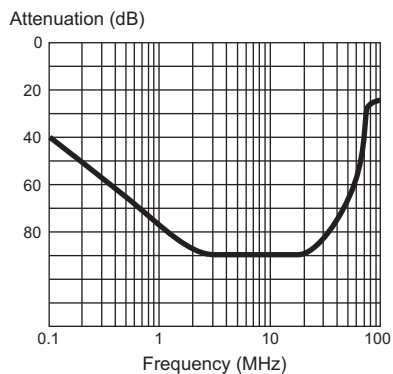


Fig. 2. Damping characteristics of noise filter (1)


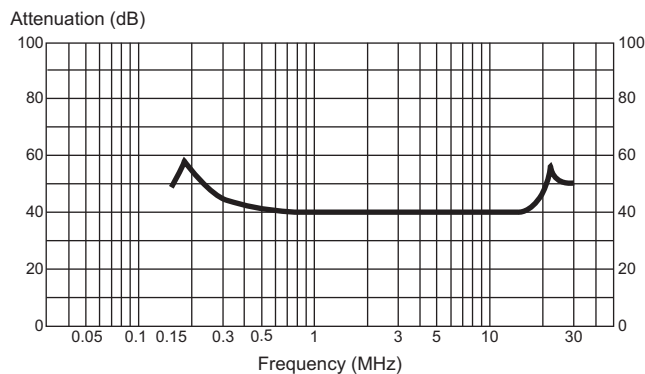


Fig. 3. Damping characteristics of noise filter (2)

- Separate and lay the input (power source side) and output (device side) cable away from the noise filter. Do not bundle the input cable together and do not lay it close to the output cable. If input and output cables are installed together, interference may result due to noise being inducted to the input cable from the output cable.

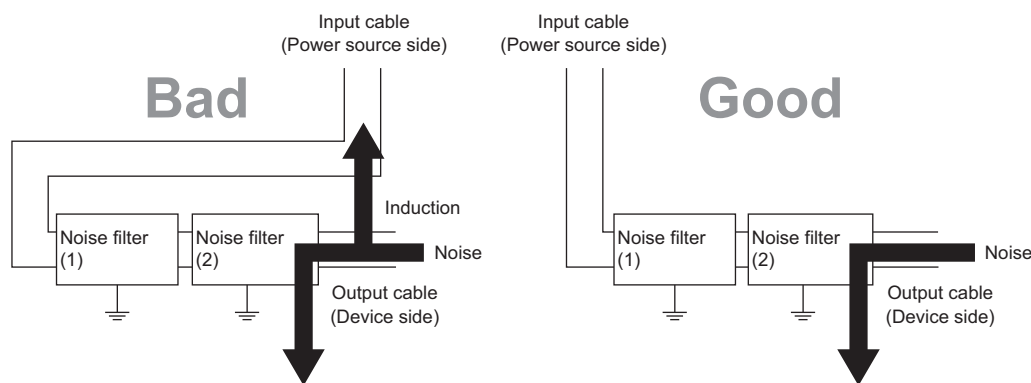

Installing the input and output cables together will cause noise induction.

Separate the input cable from the output cable.

Fig. 4. Precautions on noise filter

- Grounding wires of the noise filter should be as short as possible.

3.4 Ferrite Core

Always attach a ferrite core to cables that extend outside the control panel, including power cable.

Mitsubishi Electric performed the EMC test with 2 turns around NEC Tokin ESD-SR-250.

3.5 Power Supply

Use a DC power source other than battery to supply power to DC power type main units.

FAM-A-0003-A

REVISIONS

Version	Date of Issue	Revision
A	June 2020	The issue number of HIME-T-P-0151 has been changed. The descriptions for the certificate No., test standard, and term of validity have been changed.