

## BV Certificate Approval and Relevant Requirements for MELSEC iQ-F Series

**■Date of Issue**

August 2020 (Ver. C: March 2025)

**■Relevant Models**

MELSEC iQ-F series

Thank you for your continued support of programmable controller MELSEC iQ-F series.

The following FX5 CPU modules, extension modules, connector conversion adapters, connector conversion modules, bus conversion modules, expansion boards, and expansion adapters of the MELSEC iQ-F series have also acquired the type approval certificate for Programmable Logic Control Units from BV (Bureau Veritas).

### 1 APPLICABLE MODELS

Item	Model name
CPU module	FX5U-32MR/ES, FX5U-32MT/ES, FX5U-32MT/ESS, FX5U-64MR/ES, FX5U-64MT/ES, FX5U-64MT/ESS, FX5U-80MR/ES, FX5U-80MT/ES, FX5U-80MT/ESS, FX5U-32MR/DS, FX5U-32MT/DS, FX5U-32MT/DSS, FX5U-64MR/DS, FX5U-64MT/DS, FX5U-64MT/DSS, FX5U-80MR/DS, FX5U-80MT/DS, FX5U-80MT/DSS, FX5UC-32MT/D, FX5UC-32MT/DSS, FX5UC-64MT/D, FX5UC-64MT/DSS, FX5UC-96MT/D, FX5UC-96MT/DSS, FX5UC-32MT/DS-TS, FX5UC-32MT/DSS-TS, FX5UC-32MR/DS-TS, FX5UJ-24MR/ES, FX5UJ-24MT/ES, FX5UJ-24MT/ESS, FX5UJ-40MR/ES, FX5UJ-40MT/ES, FX5UJ-40MT/ESS, FX5UJ-60MR/ES, FX5UJ-60MT/ES, FX5UJ-60MT/ESS, FX5UJ-24MR/DS, FX5UJ-24MT/DS, FX5UJ-24MT/DSS, FX5UJ-40MR/DS, FX5UJ-40MT/DS, FX5UJ-40MT/DSS, FX5UJ-60MR/DS, FX5UJ-60MT/DS, FX5UJ-60MT/DSS, FX5S-30MR/ES, FX5S-30MT/ES, FX5S-30MT/ESS, FX5S-40MR/ES, FX5S-40MT/ES, FX5S-40MT/ESS, FX5S-60MR/ES, FX5S-60MT/ES, FX5S-60MT/ESS, FX5S-80MR/ES*1, FX5S-80MT/ES*1, FX5S-80MT/ESS*1, FX5S-30MR/DS, FX5S-30MT/DS, FX5S-30MT/DSS, FX5S-40MR/DS, FX5S-40MT/DS, FX5S-40MT/DSS, FX5S-60MR/DS, FX5S-60MT/DS, FX5S-60MT/DSS, FX5S-80MR/DS*1, FX5S-80MT/DS*1, FX5S-80MT/DSS*1
Extension module	FX5-8EX/ES, FX5-8EYR/ES, FX5-8EYT/ES, FX5-8EYT/ESS, FX5-16EX/ES, FX5-16EYR/ES, FX5-16EYT/ES, FX5-16EYT/ESS, FX5-16ER/ES, FX5-16ET/ES, FX5-16ET/ESS, FX5-16ET/ES-H, FX5-16ET/ESS-H, FX5-32ER/ES, FX5-32ET/ES, FX5-32ET/ESS, FX5-32ER/DS, FX5-32ET/DS, FX5-32ET/DSS, FX5-C16EX/D, FX5-C16EX/DS, FX5-C16EYT/D, FX5-C16EYT/DSS, FX5-C32EX/D, FX5-C32EX/DS, FX5-C32EYT/D, FX5-C32EYT/DSS, FX5-C32ET/D, FX5-C32ET/DSS, FX5-C32EX/DS-TS, FX5-C16EYR/D-TS, FX5-C32EYT/D-TS, FX5-C32EYT/DSS-TS, FX5-C32ET/DS-TS, FX5-C32ET/DSS-TS, FX5-1PSU-5V, FX5-C1PS-5V, FX5-4AD, FX5-8AD, FX5-4DA, FX5-CCL-MS, FX5-DP-M, FX5-ENET, FX5-ENET/IP
Connector conversion adapter	FX5-CNV-BC
Connector conversion module	FX5-CNV-IF, FX5-CNV-IFC
Bus conversion module	FX5-CNV-BUS, FX5-CNV-BUSC
Expansion board	FX5-232-BD, FX5-485-BD, FX5-422-BD-GOT
Expansion adapter	FX5-232ADP, FX5-485ADP, FX5-4AD-ADP, FX5-4DA-ADP, FX5-4AD-PT-ADP, FX5-4AD-TC-ADP

\*1 It is a regional limited model.

## 2 BV CERTIFICATION

The following table explains the acquired BV certification.

### 2.1 Acquired Certification

Item	Description
Accreditation organization	Bureau Veritas
Certificate No.*1	—
Classification	Programmable Logic Control Units
Test standard*1	—
Term of validity*1	—

\*1 Please ask your local Mitsubishi Electric distributor for the certificate No., test standard, and term of validity.

### 2.2 Certification Details

The FX5 CPU modules, extension modules, connector conversion adapters, connector conversion modules, bus conversion modules, expansion boards, and expansion adapters of the MELSEC iQ-F series certified compliant to BV Rules must be used in the following environment.

Item	Description	Remarks
EMC	Any given place on vessel (including Bridge and Deck Zone (Open Deck is excluded))*1	—
Power supply	Supply power from a DC power source other than battery.	☞ Page 3 REQUIREMENTS


\*1 Only for FX5-1PSU-5V, any given place on vessel (excluding Bridge and Deck Zone)

### 3 REQUIREMENTS

When using the FX5 CPU modules, extension modules, connector conversion adapters, connector conversion modules, bus conversion modules, expansion boards, and expansion adapters of the MELSEC iQ-F series as BV Certified Systems, make sure the following requirements are observed.

#### 3.1 Control Cabinet

- The control panel must be conductive.
- Ground the control cabinet with the thickest possible grounding cable.
- To ensure that there is electrical contact between the control cabinet and its door, connect the cabinet and its doors with thick wires. (See Fig. 1.)
- In order to suppress the leakage of radio waves, the control cabinet must be structured with minimal openings. The gap between the control cabinet and its door must be eliminated whenever possible by attaching EMI gaskets between them. To attach an EMI gasket, remove the coating on the contact area between the control cabinet and its door and attach the EMI gasket with conductive adhesive tape. In addition, wrap the cable holes with a shielding cover or other shielding devices. (See Fig. 1.)

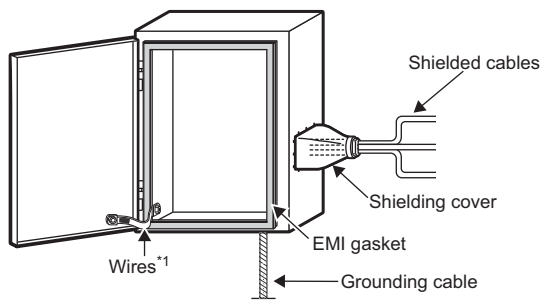

\*1 These wires are used to improve the conductivity between the door and control cabinet.

Fig. 1. Control cabinet example

- In order to avoid the effects of static electricity, make sure to eliminate static electricity when there is a possibility of touching the programmable controller in the control cabinet during maintenance or servicing.

#### 3.2 Cables

- For cables that protrude out of the control cabinet, make sure to use shielded cables and install cable clamp metal fittings.
- Connect the shields of the shielded cable, to the grounded control cabinet.

### 3.3 Noise Filter

Please attach a noise filter on the power line. (See Fig. 2.)

Mitsubishi's EMC tests were carried out using SOSHIN ELECTRIC HF3010C-SZA.

- Separate and lay the input (power source side) and output (device side) cable away from the noise filter. Do not bundle the input cable together and do not lay it close to the output cable. If input and output cables are installed together, interference may result due to noise being induced to the input cable from the output cable.

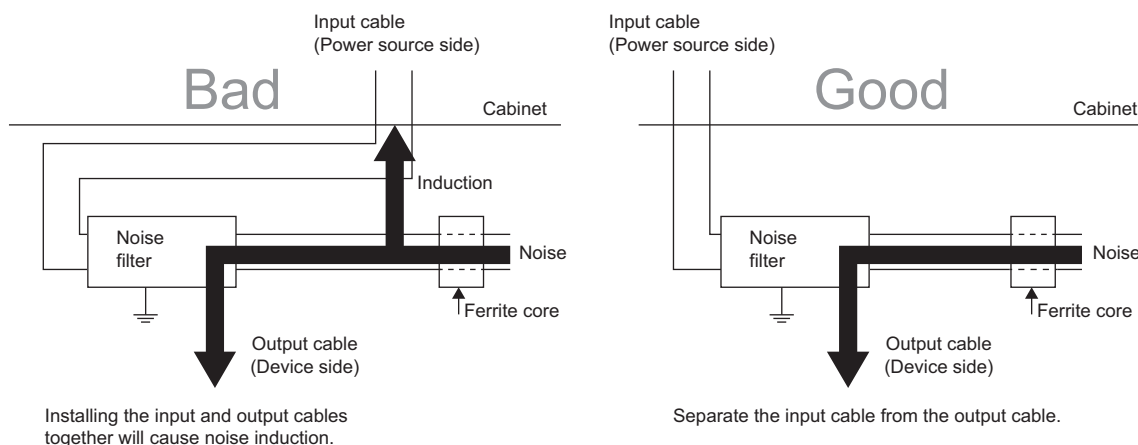


Fig. 2. Precautions on noise filter

- Grounding wires of the noise filter should be as short as possible.

### 3.4 Ferrite Core

#### When an FX5UJ CPU module is used

Make sure to attach a ferrite core to all cables that extend outside the control cabinet, including power cables.

Mitsubishi Electric performs the EMC test using the cable passing through SEIWA ELECTRIC E04SR401938 twice (2 turns). (AC power supply type only)

The test is performed using the Ethernet cable passing through TDK Corporation ZCAT2035-0930A once (1 turn).

#### When an FX5S CPU module is used

Mitsubishi Electric performs the EMC test using the Ethernet cable passing through TDK Corporation ZCAT2035-0930A once (1 turn).

#### When a module other than the FX5UJ and FX5S CPU modules is used

Make sure to attach a ferrite core to all cables that extend outside the control cabinet, including power cables.

Mitsubishi Electric performs the EMC test using the cable passing through SEIWA ELECTRIC E04SR401938 once (1 turn).

For the following modules, the test is performed using the power cable passing through the above ferrite core twice (2 turns).

Target module: FX5UC-32MR/DS-TS, FX5-4DA, FX5-CCL-MS

For the CPU module connected to the following modules, the test is performed using the power cable passing through the above ferrite core twice (2 turns).

Target module: FX5-C16EYR/D-TS, FX5-4AD, FX5-4DA, FX5-CCL-MS, FX5-DP-M, FX5-ENET, FX5-ENET/IP

### 3.5 Power Supply

Use a certified DC power supply other than battery to supply power to DC power type CPU module.

**REVISIONS**

Version	Date of Issue	Revision
A	August 2020	Change of the issue number from HIME-T-P-0176. Addition of the detailed information of the EMC test.
B	June 2022	<ul style="list-style-type: none"> <li>• Addition of the following modules to the applicable models. FX5UJ-24MR/ES, FX5UJ-24MT/ES, FX5UJ-24MT/ESS, FX5UJ-40MR/ES, FX5UJ-40MT/ES, FX5UJ-40MT/ESS, FX5UJ-60MR/ES, FX5UJ-60MT/ES, FX5UJ-60MT/ESS, FX5-ENET/IP</li> <li>• Modification of the following parts. Chapter 2 BV CERTIFICATION Section 3.4 Ferrite Core</li> <li>• Addition of the TRADEMARKS section.</li> </ul>
C	March 2025	<ul style="list-style-type: none"> <li>• Addition of the following modules to the applicable models. FX5UJ-24MR/DS, FX5UJ-24MT/DS, FX5UJ-24MT/DSS, FX5UJ-40MR/DS, FX5UJ-40MT/DS, FX5UJ-40MT/DSS, FX5UJ-60MR/DS, FX5UJ-60MT/DS, FX5UJ-60MT/DSS, FX5S-30MR/ES, FX5S-30MT/ES, FX5S-30MT/ESS, FX5S-40MR/ES, FX5S-40MT/ES, FX5S-40MT/ESS, FX5S-60MR/ES, FX5S-60MT/ES, FX5S-60MT/ESS, FX5S-80MR/ES, FX5S-80MT/ES, FX5S-80MT/ESS, FX5S-30MR/DS, FX5S-30MT/DS, FX5S-30MT/DSS, FX5S-40MR/DS, FX5S-40MT/DS, FX5S-40MT/DSS, FX5S-60MR/DS, FX5S-60MT/DS, FX5S-60MT/DSS, FX5S-80MR/DS, FX5S-80MT/DS, FX5S-80MT/DSS</li> <li>• Modification of the following parts. Section 3.4 Ferrite Core</li> </ul>

**TRADEMARKS**

The company names, system names, and product names mentioned in this technical bulletin are either registered trademarks or trademarks of their respective companies.

In some cases, trademark symbols such as <sup>™</sup> or <sup>®</sup> are not specified in this technical bulletin.